



**Technical and Test Institute
for Construction Prague**
Prosecká 811/76a
190 00 Prague
Czech Republic
eota@tzus.cz



European Technical Assessment **ETA 18/0675**
of 08/07/2024

| | |
|---|--|
| Technical Assessment Body issuing the ETA: | Technical and Test Institute for Construction Prague |
| Trade name of the construction product | ChemSet™ Reo502™ Plus ChemSet™ Epcon™ C6 Plus ChemSet™ Epcon™ G5 PRO |
| Product family to which the construction product belongs | Product area code: 33 Bonded injection type anchor for use in cracked and uncracked concrete |
| Manufacturer | Ramsetreid A Division of ITW Australia Pty Ltd 1 Ramset Drive, Chirnside Park. Vic 3116 Australia |
| Manufacturing plant | Ramsetreid Plant 3 |
| This European Technical Assessment contains | 23 pages including 20 Annexes which form an integral part of this assessment. |
| This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of | EAD 330499-01-0601 Bonded fasteners for use in concrete |
| This version replaces | ETA 18/0675 issued on 06/06/2021 |

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body - Technical and Test Institute for Construction Prague. Any partial reproduction has to be identified as such.

1. Technical description of the product

The ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus, ChemSet™ Epcon™ G5 PRO with steel elements is bonded anchor (injection type).

Steel elements can be galvanized or stainless steel threaded rods or rebars.

Steel element is placed into a drilled hole filled with injection mortar. The steel element is anchored via the bond between metal part, injection mortar and concrete. The anchor is intended to be used with various embedment depth up to 20 diameters.

The illustration and the description of the product are given in Annex A.

2. Specification of the intended use in accordance with the applicable EAD

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years and 100 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the products in relation to the expected economically reasonable working life of the works.

3. Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|---|-----------------------|
| Characteristic resistance to tension load (static and quasi-static loading) | See Annex C 1 to C 5 |
| Characteristic resistance to shear load (static and quasi-static loading) | See Annex C 6 to C 7 |
| Displacements under short-term and long-term loading | See Annex C 8 |
| Characteristic resistance and displacement for seismic performance categories C1 and C2 | See Annex C 9 to C 11 |

3.2 Hygiene, health and environment (BWR 3)

No performance determined.

3.3 General aspects relating to fitness for use

Durability and serviceability are only ensured if the specifications of intended use according to Annex B 1 are kept.

4. Assessment and verification of constancy of performance (AVCP) system applied with reference to its legal base

According to the Decision 96/582/EC of the European Commission¹ the system of assessment verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table apply.

| Product | Intended use | Level or class | System |
|-----------------------------------|--|----------------|--------|
| Metal anchors for use in concrete | For fixing and/or supporting to concrete, structural elements (which contributes to the stability of the works) or heavy units | - | 1 |

¹ Official Journal of the European Communities L 254 of 08.10.1996

5. Technical details necessary for the implementation of the AVCP system, as provided in the applicable EAD

The factory production control shall be in accordance with the control plan which is a part of the technical documentation of this European Technical Assessment. The control plan is laid down in the context of the factory production control system operated by the manufacturer and deposited at Technický a zkušební ústav stavební Praha, s.p.² The results of factory production control shall be recorded and evaluated in accordance with the provisions of the control plan.

Issued in Prague on 08.07.2024


By

Ing. Jiří Studnička, Ph.D.
Head of the Technical Assessment Body




² The control plan is a confidential part of the documentation of the European Technical Assessment, but not published together with the ETA and only handed over to the approved body involved in the procedure of AVCP.

Threaded rod

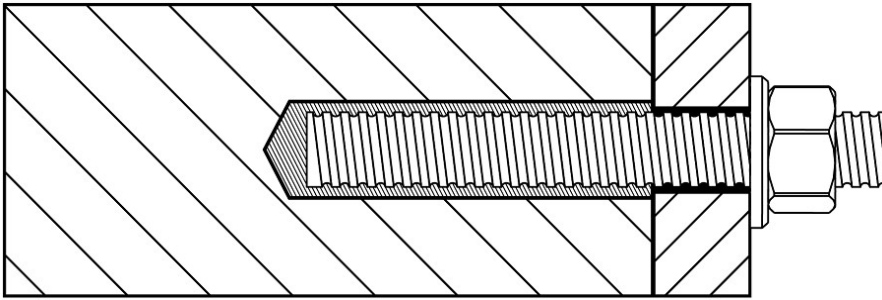

Reinforcing bar

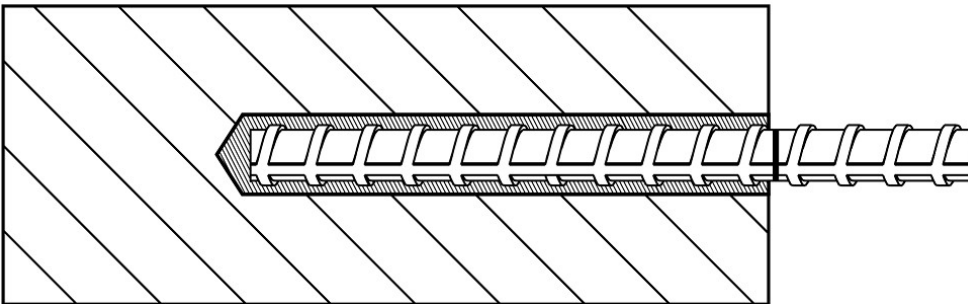

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**


Product description
Installed conditions

Annex A 1

Mortar cartridges


Coaxial cartridge

Chemset™ Reo502™ Plus, 600 ml
 ChemSet™ Epcon™ C6 Plus
 ChemSet™ Epcon™ G5 PRO

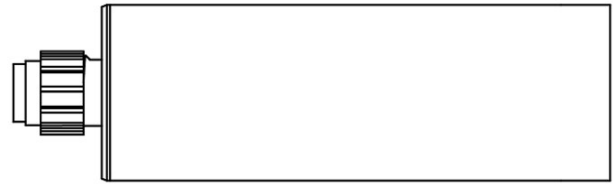

Side by side cartridge

Chemset™ Reo502™ Plus, 450 ml
 ChemSet™ Epcon™ C6 Plus
 ChemSet™ Epcon™ G5 PRO

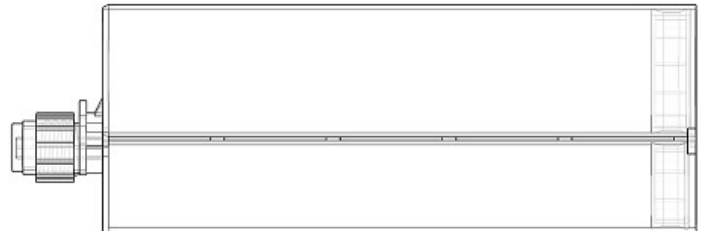

Marking of the mortar cartridges

Identifying mark of the producer, Trade name, Charge code number, Storage life, Curing and processing time

Mixing nozzle

Q mixing nozzle



QH mixing nozzle



EF mixing nozzle




**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
 ChemSet™ Epcon™ G5 PRO**

Product description
 Injection system

Annex A 2

Threaded rod M8, M10, M12, M16, M20, M24, M27, M30

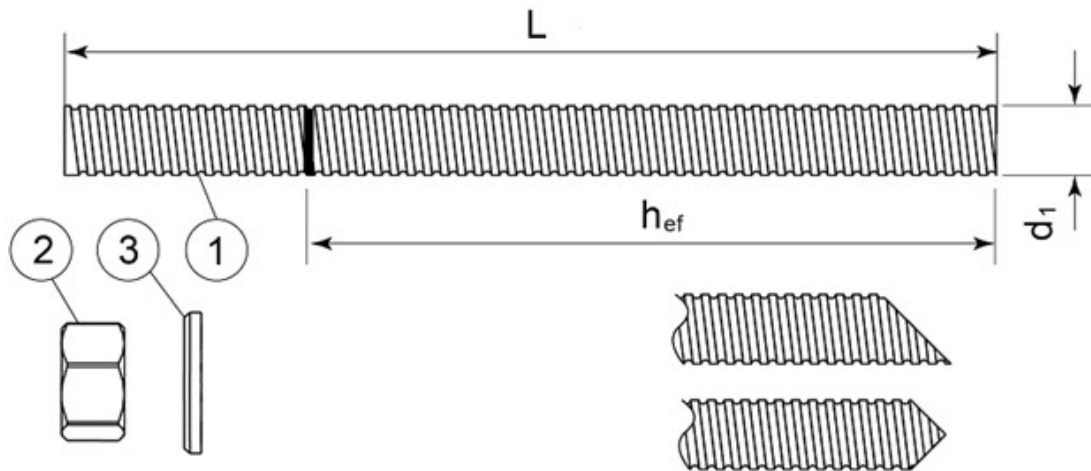

Standard commercial threaded rod with marked embedment depth

| Part | Designation | Material |
|---|--|---|
| Steel, zinc plated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042 or Steel, Hot-dip galvanized $\geq 40 \mu\text{m}$ acc. to EN ISO 1461 and EN ISO 10684 or Steel, zinc diffusion coating $\geq 15 \mu\text{m}$ acc. to EN 13811 | | |
| 1 | Anchor rod | Steel, EN 10087 or EN 10263 Property class 4.6, 5.8, 8.8, 10.9* EN ISO 898-1 |
| 2 | Hexagon nut EN ISO 4032 | According to threaded rod, EN 20898-2 |
| 3 | Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094 | According to threaded rod |
| Stainless steel | | |
| 1 | Anchor rod | Material: A2-70, A4-70, A4-80, EN ISO 3506 |
| 2 | Hexagon nut EN ISO 4032 | According to threaded rod |
| 3 | Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094 | According to threaded rod |
| High corrosion resistant steel | | |
| 1 | Anchor rod | Material: 1.4529, 1.4565, EN 10088-1 |
| 2 | Hexagon nut EN ISO 4032 | According to threaded rod |
| 3 | Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094 | According to threaded rod |

*Galvanized rod of high strength are sensitive to hydrogen induced brittle failure

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

Product description
Threaded rod and materials

Annex A 3

Rebar Ø8, Ø10, Ø12, Ø16, Ø20, Ø25, Ø32



Standard commercial reinforcing bar with marked embedment depth

| Product form | | Bars and de-coiled rods | |
|--|-----------------------|--------------------------------|-----------------------|
| Class | | B | C |
| Characteristic yield strength f_{yk} or $f_{0,2k}$ (MPa) | | 400 to 600 | |
| Minimum value of $k = (f_t/f_y)_k$ | | $\geq 1,08$ | $\geq 1,15$ < 1,35 |
| Characteristic strain at maximum force ϵ_{uk} (%) | | $\geq 5,0$ | $\geq 7,5$ |
| Bendability | | Bend/Rebend test | |
| Maximum deviation from nominal mass (individual bar) (%) | Nominal bar size (mm) | $\pm 6,0$ $\pm 4,5$ | |
| | ≤ 8 > 8 | | |
| Bond: Minimum relative rib area, $f_{R,min}$ | Nominal bar size (mm) | 0,040 0,056 | |
| | 8 to 12 > 12 | | |

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

Product description
Rebars and materials

Annex A 4

Specifications of intended use

Anchorage subject to:

- Static and quasi-static load
- Seismic actions category C1 (max w = 0,5 mm):
 - threaded rod size M8, M10, M12, M16, M20, M24, M27, M30
 - rebar size Ø10, Ø12, Ø16, Ø20, Ø25, Ø32
- Seismic actions category C2 (max w = 0,8 mm): threaded rod size M12, M16, M20

Base materials

- Cracked and uncracked concrete
- Reinforced or unreinforced normal weight concrete of strength class C20/25 at minimum and C50/60 at maximum according EN 206:2013.

Temperature range:

- -40°C to +70°C (max. short. term temperature +70°C and max. long term temperature +50°C)

Use conditions (Environmental conditions)

- (X1) Structures subject to dry internal conditions (zinc coated steel, stainless steel, high corrosion resistance steel).
- (X2) Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel A4, high corrosion resistant steel).
- (X3) Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel).

Note: *Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).*

Concrete conditions:

- I1 – installation in dry or wet (water saturated) concrete and use in service in dry or wet concrete.
- I2 – installation in water-filled (not sea water) and use in service in dry or wet concrete

Design:

- The anchorages are designed in accordance with the EN 1992-4 under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings.
- Anchorages under seismic actions (cracked concrete) have to be designed in accordance with EN 1992-4.

Installation:

- Hole drilling by hammer drilling, dustless drilling or diamond core drilling mode.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

Installation direction:

- D3 – downward and horizontal and upwards (e.g. overhead) installation

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

**Intended use
Specifications**

Annex B 1

HDB – Hollow Drill Bit System


Heller Duster Expert hollow drill bit
 SDS-Plus ≤ 16mm
 SDS-Max ≥ 16mm



Cleaning steel brush



Brush extensions

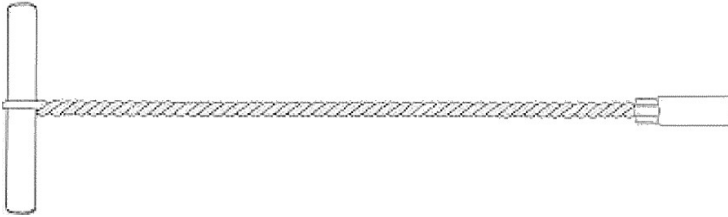

Applicator gun


A



A1



B

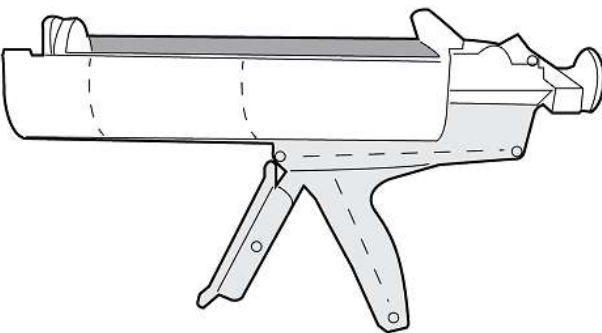


| | | |
|----------------|-------------------|------------------------|
| Applicator gun | A (A1) | B |
| Cartridge | Coaxial 600 ml | Side by side 450 ml |

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
 ChemSet™ Epcon™ G5 PRO**

Intended use
 Hollow drill bit system, Cleaning brush
 Applicator guns

Annex B 2


SOLID SUBSTRATE INSTALLATION METHOD

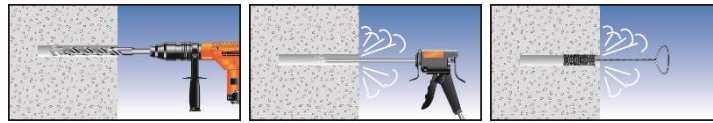

1. Using the SDS hammer drill (HD) in rotary hammer mode for drilling, with a carbide tipped drill bit of the appropriate size, drill the hole to the specified hole diameter and depth.
2. Select the correct air lance, insert to the bottom of the hole, and depress the trigger for 2 seconds. The compressed air must be clean and free from water and oil, with a minimum pressure of 90 psi (6 bar). Perform the blowing operation twice.
3. Select the correct size hole cleaning brush. Ensure that the brush is in good condition and of the correct diameter. Insert the brush to the bottom of the hole, using a brush extension if needed to reach the bottom. Withdraw with a twisting motion. There should be a positive interaction between the bristles of the brush and the sides of the drilled hole. Perform the brushing operation twice.
4. Repeat step 2 (blowing operation x2)
5. Repeat step 3 (brushing operation x2)
6. Repeat step 2 (blowing operation x2)



7. Select the most appropriate static mixer nozzle, checking that the mixing elements are present and fit for purpose. Never modify the mixer. Attach the mixer nozzle to the cartridge. Check the dispensing tool is in good working order. Place the cartridge into the dispensing tool.
8. Extrude some resin to waste until an even coloured mixture is achieved. The cartridge is now ready for use.
9. Insert the mixing nozzle to the bottom of the hole. Extrude the resin and slowly withdraw the nozzle from the hole. Ensure no air voids are created as the nozzle is withdrawn. Inject resin until the hole is approximately $\frac{3}{4}$ full and remove the nozzle from the hole

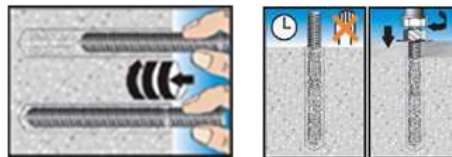

10. Select the steel anchor element ensuring it is free from oil or other contaminants, and mark with the required embedment depth. Insert the steel element into the hole using a back and forth twisting motion to ensure complete cover, until it reaches the bottom of the hole. Excess resin will be expelled from the hole evenly around the steel element and there shall be no gaps between the anchor element and the wall of the drilled hole.
11. Clean any excess resin from around the mouth of the hole.
12. Refer to the working and loading times within the tables to determine the appropriate cure time.
13. Position the fixture and tighten the anchor to the appropriate installation torque. Do not over-torque the anchor, as this could adversely affect its performance.


**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

Intended use
Installation procedure

Annex B 3

DEEP EMBEDMENT & OVERHEAD INSTALLATION METHOD

1a. Perform steps 1-8 under “solid substrate installation method”.

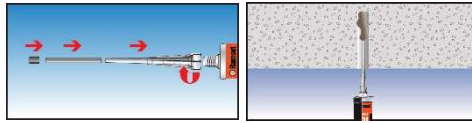


2a. Attach the correct diameter and length extension tube to the nozzle. Select the correct diameter resin stopper for the application, then push and screw the extension tube into the resin stopper. This is held in place with a coarse internal thread. The resin stopper is a reusable accessory.

3a. Push the resin stopper and extension tube to the back of the drill hole.

4a. Ensure the extension tube is angled to allow free movement of the resin stopper as the resin is extruded.

5a. Continue from step 10 under “solid substrate installation method”

DIAMOND CORE DRILLING

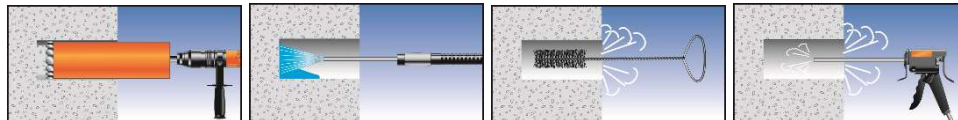

1b. Using a diamond core drill (DD) and following the manufacturer’s instructions, drill the specified diameter hole to the correct embedment depth then remove the concrete core.

2b. Starting from the back of the hole, flush with pressurised water a minimum of two times and until there is only clean water.

3b. Select the correct size hole cleaning brush. Ensure that the brush is in good condition and of the correct diameter. Insert the brush to the bottom of the hole, using a brush extension if needed to reach the bottom. Withdraw with a twisting motion. There should be a positive interaction between the bristles of the brush and the sides of the drilled hole. Perform the brushing operation twice.


4b. Repeat step 2b (flushing operation x2).

5b. Repeat step 3b (brushing operation x2).

6b. Using the correct air lance and starting from the back of the hole and withdrawing, perform a minimum of two blowing operations and ensure that the hole is clear of debris and excess water.

7b. Continue from step 7 under “solid substrate installation method”.

DUSTLESS DRILLING

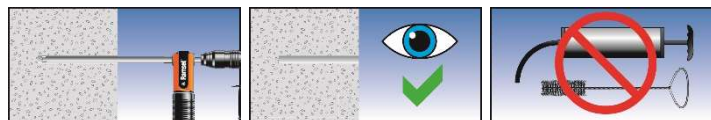

1b. Using the specified hollow drill bit (HDB) and vacuum system and following the manufacturer’s instructions, drill the specified diameter hole to the correct embedment depth. Ensure that the minimum vacuum specifications are met and that the vacuum is turned on.

2b. The hole should be inspected to ensure the system has worked correctly. If the hole is clear of dust and debris, no further cleaning is required.

3b. Continue from step 7 under “solid substrate installation method”.

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

Intended use
Installation procedure

Annex B 4

Table B1: Installation parameters of threaded rod

| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|---|-----------------------------|---|-------------------|-------------------|------------------------|-------------------|-------------------|-------------------|-------------------|
| Nominal drill hole diameter | $\varnothing d_0$ [mm] | 10 | 12 | 14 | 18 | 22 | 26 | 30 | 35 |
| Cleaning brush | | S11HF | S14HF | S14/15HF | S22HF | S24HF | S31HF | S31HF | S38HF |
| Torque moment | $\max T_{\text{fixt}}$ [Nm] | 10 | 20 | 40 | 80 | 120 | 160 | 180 | 200 |
| Embedment depth for $h_{\text{ef,min}}$ | h_{ef} [mm] | 60 | 60 | 70 | 80 | 90 | 96 | 108 | 120 |
| Embedment depth for $h_{\text{ef,max}}$ | h_{ef} [mm] | 160 | 200 | 240 | 320 | 400 | 480 | 540 | 600 |
| Depth of drill hole | h_0 [mm] | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ |
| Minimum edge distance | c_{min} [mm] | 40 | 40 | 40 | 40 | 50 | 50 | 50 | 60 |
| Minimum spacing | s_{min} [mm] | 40 | 40 | 40 | 40 | 50 | 50 | 50 | 60 |
| Minimum thickness of member | h_{min} [mm] | $h_{\text{ef}} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{\text{ef}} + 2d_0$ | | | | |

Table B2: Installation parameters of rebar

| Size | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
|---|-----------------------------|---|-------------------|-------------------|------------------------|-------------------|-------------------|-------------------|
| Nominal drill hole diameter | $\varnothing d_0$ [mm] | 12 | 14 | 16 | 20 | 25 | 32 | 40 |
| Cleaning brush | | S12/13HF | S14/15HF | S18HF | S22HF | S27HF | S35HF | S43HF |
| Torque moment | $\max T_{\text{fixt}}$ [Nm] | 10 | 20 | 40 | 80 | 120 | 180 | 200 |
| Embedment depth for $h_{\text{ef,min}}$ | h_{ef} [mm] | 60 | 60 | 70 | 80 | 90 | 100 | 128 |
| Embedment depth for $h_{\text{ef,max}}$ | h_{ef} [mm] | 160 | 200 | 240 | 320 | 400 | 500 | 640 |
| Depth of drill hole | h_0 [mm] | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ | $h_{\text{ef}}+5$ |
| Minimum edge distance | c_{min} [mm] | 40 | 40 | 40 | 40 | 50 | 50 | 70 |
| Minimum spacing | s_{min} [mm] | 40 | 40 | 40 | 40 | 50 | 50 | 70 |
| Minimum thickness of member | h_{min} [mm] | $h_{\text{ef}} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{\text{ef}} + 2d_0$ | | | |

Table B3: Minimum curing time

| Base Material Temperature [°C] | Cartridge Temperature [°C] | T Work [mins] | T Load [hrs] |
|---|----------------------------|---------------|--------------|
| +5 | Minimum +10 | 300 | 24 |
| +5°C to +10 | | 150 | |
| +10°C to +15 | +10°C to +15 | 40 | 18 |
| +15°C to +20 | +15°C to +20 | 25 | 12 |
| +20°C to +25 | +20°C to +25 | 18 | 8 |
| +25°C to +30 | +25°C to +30 | 12 | 6 |
| +30°C to +35 | +30°C to +35 | 8 | 4 |
| +35°C to +40 | +35°C to +40 | 6 | 2 |
| Ensure cartridge is $\geq 10^\circ\text{C}$ | | | |

T Work is typical gel time at highest base material temperature in the range.

T Load is minimum set time required until load can be applied at the lowest temperature in the range.

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

Intended use
Installation parameters
Curing time

Annex B 5

Table C1: Design method EN 1992-4
Steel failure - Characteristic values of resistance to tension load of threaded rod

| Steel failure – Characteristic resistance | | | | | | | | | | | |
|---|---------------|------|------|-----|-----|-----|-----|-----|-----|-----|--|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Steel grade 4.6 | $N_{Rk,s}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 | |
| Partial safety factor | γ_{Ms} | [-] | 2,00 | | | | | | | | |
| Steel grade 5.8 | $N_{Rk,s}$ | [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 | |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | | |
| Steel grade 8.8 | $N_{Rk,s}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 | |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | | |
| Steel grade 10.9 | $N_{Rk,s}$ | [kN] | 37 | 58 | 84 | 157 | 245 | 353 | 459 | 561 | |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | | | | |
| Stainless steel grade A2-70, A4-70 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 | |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | | |
| Stainless steel grade A4-80 | $N_{Rk,s}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 | |
| Partial safety factor | γ_{Ms} | [-] | 1,60 | | | | | | | | |
| Stainless steel grade 1.4529 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 | |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | | |
| Stainless steel grade 1.4565 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 | |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | | |

Table C2: Design method EN 1992-4
Steel failure - Characteristic values of resistance to tension load of rebar

| Steel failure – Characteristic resistance | | | | | | | | | | |
|---|---------------|------|-----|-----|-----|-----|-----|-----|-----|--|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 | |
| Rebar BSt 500 S | $N_{Rk,s}$ | [kN] | 28 | 43 | 62 | 111 | 173 | 270 | 442 | |
| Partial safety factor | γ_{Ms} | [-] | 1,4 | | | | | | | |

ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO

Performances
Steel failure characteristic resistance

Annex C 1

Table C3: Design method EN 1992-4
Characteristic values of resistance to tension load of threaded rod

| Combined pullout and concrete cone failure in concrete C20/25 | | | | | | | | | |
|--|--------------------------------------|--------------|------|------|------|------|------|------|-----|
| Hammer drilling, Dustless drilling | | | | | | | | | |
| Size | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Characteristic bond resistance in uncracked concrete for a working life of 50 years and 100 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{RK,ucr}$ [N/mm ²] | 17,0 | 15,0 | 15,0 | 12,0 | 12,0 | 12,0 | 11,0 | 9,5 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | | |
| Dry, wet concrete | γ_{inst} [-] | | | | 1,0 | | | | |
| Hammer drilling – Flooded hole | γ_{inst} [-] | | | | 1,0 | | | | |
| Dustless drilling – Flooded hole | γ_{inst} [-] | | | | 1,2 | | | | |
| Characteristic bond resistance in cracked concrete for a working life of 50 years and 100 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{RK,cr}$ [N/mm ²] | 10,0 | 10,0 | 10,0 | 9,5 | 9,0 | 9,0 | 6,0 | 6,0 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | | |
| Dry, wet concrete | γ_{inst} [-] | | | | 1,0 | | | | |
| Hammer drilling – Flooded hole | γ_{inst} [-] | | | | 1,0 | | | | |
| Dustless drilling – Flooded hole | γ_{inst} [-] | | | | 1,2 | | | | |
| Factor for influence of sustained load for a working life 50 years | ψ^0_{sus} [-] | | | | 0,72 | | | | |
| Factor for concrete | C25/30 | ψ_c [-] | | | 1,02 | | | | |
| | C30/37 | | | | 1,04 | | | | |
| | C35/45 | | | | 1,06 | | | | |
| | C40/50 | | | | 1,07 | | | | |
| | C45/55 | | | | 1,08 | | | | |
| | C50/60 | | | | 1,09 | | | | |

| Concrete cone failure | | | |
|---|-----------------|-----|--------------|
| Factor for concrete cone failure for uncracked concrete | $k_{Ucr,N}$ | [-] | 11 |
| Factor for concrete cone failure for cracked concrete | $k_{Cr,N}$ | | 7,7 |
| Edge distance | $C_{Cr,N}$ [mm] | | 1,5 h_{ef} |

| Splitting failure | | | | | | | | | |
|--------------------------|------------------|-----|-----|-----|---------------|-----|-----|-----|--|
| Size | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Edge distance | $C_{Cr,sp}$ [mm] | | | | 2 h_{ef} | | | | |
| Spacing | $S_{Cr,sp}$ [mm] | | | | 2 $C_{Cr,sp}$ | | | | |

ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus, ChemSet™ Epcon™ G5 PRO

Performances
Hammer drilling, Dustless drilling
Characteristic resistance for tension loads - threaded rod

Annex C 2

Table C4: Design method EN 1992-4
Characteristic values of resistance to tension load of rebar

| Combined pullout and concrete cone failure in concrete C20/25 | | | | | | | | | |
|--|-----------------|----------------------|---------------|------|------|------|------|------|-----|
| Hammer drilling, Dustless drilling | | | | | | | | | |
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Characteristic bond resistance in uncracked concrete for a working life of 50 years and 100 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 13,0 | 13,0 | 13,0 | 12,0 | 12,0 | 12,0 | 8,0 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | | |
| Hammer drilling - Dry, wet concrete | γ_{inst} | [-] | 1,0 | | | | | | |
| Dustless drilling - Dry, wet concrete | γ_{inst} | [-] | 1,2 | | | | | | |
| Flooded hole | γ_{inst} | [-] | 1,2 | | | | | | |
| Characteristic bond resistance in cracked concrete for a working life of 50 years and 100 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,cr}$ | [N/mm ²] | 8,0 | 11,0 | 10,0 | 10,0 | 9,0 | 8,5 | 6,5 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | | |
| Hammer drilling - Dry, wet concrete | γ_{inst} | [-] | 1,0 | | | | | | |
| Dustless drilling - Dry, wet concrete | γ_{inst} | [-] | 1,2 | | | | | | |
| Flooded hole | γ_{inst} | [-] | 1,2 | | | | | | |
| Factor for influence of sustained load for a working life 50 years | ψ^0_{sus} | [-] | 0,72 | | | | | | |
| Factor for concrete | ψ_c | [-] | C25/30 | 1,02 | | | | | |
| | | | C30/37 | 1,04 | | | | | |
| | | | C35/45 | 1,06 | | | | | |
| | | | C40/50 | 1,07 | | | | | |
| | | | C45/55 | 1,08 | | | | | |
| | | | C50/60 | 1,09 | | | | | |
| Concrete cone failure | | | | | | | | | |
| Factor for concrete cone failure for uncracked concrete | $k_{ucr,N}$ | [-] | 11 | | | | | | |
| Factor for concrete cone failure for cracked concrete | $k_{cr,N}$ | | 7,7 | | | | | | |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} | | | | | | |
| Splitting failure | | | | | | | | | |
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Edge distance | $c_{cr,sp}$ | [mm] | 2 h_{ef} | | | | | | |
| Spacing | $s_{cr,sp}$ | [mm] | 2 $c_{cr,sp}$ | | | | | | |

ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus, ChemSet™ Epcon™ G5 PRO

Performances

Hammer drilling, Dustless drilling
Characteristic resistance for tension loads - rebar

Annex C 3

Table C5: Design method EN 1992-4

Characteristic values of resistance to tension load of threaded rod

| Combined pullout and concrete cone failure in concrete C20/25 | | | | | | | | | |
|--|--------------------------------------|----------|------|------|------|------|------|------|-----|
| Diamond core drilling | | | | | | | | | |
| Size | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Characteristic bond resistance in uncracked concrete for a working life of 50 years and 100 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,ucr}$ [N/mm ²] | 16,0 | 15,0 | 15,0 | 12,0 | 12,0 | 12,0 | 11,0 | 9,5 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | | |
| Dry, wet concrete | γ_{inst} | [-] | | 1,0 | | | | | |
| Flooded hole | γ_{inst} | [-] | | 1,2 | | | | | |
| Characteristic bond resistance in cracked concrete for a working life of 50 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,cr}$ [N/mm ²] | 10,0 | 10,0 | 10,0 | 9,5 | 8,5 | 9,0 | 6,0 | 6,0 |
| Characteristic bond resistance in cracked concrete for a working life of 100 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,cr}$ [N/mm ²] | 8,5 | 9,0 | 9,0 | 8,5 | 8,0 | 8,0 | 6,0 | 5,5 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | | |
| Dry, wet concrete | γ_{inst} | [-] | | 1,0 | | | | | |
| Flooded hole | γ_{inst} | [-] | | 1,2 | | | | | |
| Factor for influence of sustained load for a working life 50 years | ψ^{0}_{sus} | [-] | | 0,76 | | | | | |
| Factor for concrete | C25/30 | ψ_c | [-] | 1,02 | | | | | |
| | C30/37 | | | 1,04 | | | | | |
| | C35/45 | | | 1,06 | | | | | |
| | C40/50 | | | 1,07 | | | | | |
| | C45/55 | | | 1,08 | | | | | |
| | C50/60 | | | 1,09 | | | | | |

| Concrete cone failure | | | |
|---|-------------|------|--------------|
| Factor for concrete cone failure for uncracked concrete | $k_{ucr,N}$ | [-] | 11 |
| Factor for concrete cone failure for cracked concrete | $k_{cr,N}$ | | 7,7 |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} |

| Splitting failure | | | | | | | | | |
|--------------------------|-------------|------|-----|---------------|-----|-----|-----|-----|--|
| Size | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Edge distance | $c_{cr,sp}$ | [mm] | | 2 h_{ef} | | | | | |
| Spacing | $s_{cr,sp}$ | [mm] | | 2 $c_{cr,sp}$ | | | | | |

ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus, ChemSet™ Epcon™ G5 PRO

Performances

Diamond core drilling

Characteristic resistance for tension loads - threaded rod

Annex C 4

Table C6: Design method EN 1992-4
Characteristic values of resistance to tension load of rebar

| Combined pullout and concrete cone failure in concrete C20/25 | | | | | | | | | |
|--|-----------------|----------------------|------|------|------|------|------|------|-----|
| Diamond core drilling | | | | | | | | | |
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Characteristic bond resistance in uncracked concrete for a working life of 50 years and 100 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 13,0 | 12,0 | 13,0 | 12,0 | 11,0 | 11,0 | 8,0 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | | |
| Dry, wet concrete | γ_{inst} | [-] | 1,0 | | | | | | |
| Flooded hole | γ_{inst} | [-] | 1,2 | | | | | | |
| Characteristic bond resistance in cracked concrete for a working life of 50 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,cr}$ | [N/mm ²] | 8,0 | 8,0 | 8,0 | 8,0 | 7,0 | 6,5 | 6,0 |
| Characteristic bond resistance in cracked concrete for a working life of 100 years | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,cr}$ | [N/mm ²] | 6,5 | 7,0 | 7,0 | 7,0 | 7,0 | 6,0 | 5,5 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | | |
| Dry, wet concrete | γ_{inst} | [-] | 1,0 | | | | | | |
| Flooded hole | γ_{inst} | [-] | 1,2 | | | | | | |
| Factor for influence of sustained load for a working life 50 years | ψ^0_{sus} | [-] | 0,76 | | | | | | |
| Factor for concrete | C25/30 | ψ_c | [-] | 1,02 | | | | | |
| | C30/37 | | | 1,04 | | | | | |
| | C35/45 | | | 1,06 | | | | | |
| | C40/50 | | | 1,07 | | | | | |
| | C45/55 | | | 1,08 | | | | | |
| | C50/60 | | | 1,09 | | | | | |

| Concrete cone failure | | | |
|---|-------------|------|--------------|
| Factor for concrete cone failure for uncracked concrete | $k_{ucr,N}$ | [-] | 11 |
| Factor for concrete cone failure for cracked concrete | $k_{cr,N}$ | | 7,7 |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} |

| Splitting failure | | | | | | | | | |
|--------------------------|-------------|------|---------------|-----|-----|-----|-----|-----|-----|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Edge distance | $c_{cr,sp}$ | [mm] | 2 h_{ef} | | | | | | |
| Spacing | $s_{cr,sp}$ | [mm] | 2 $c_{cr,sp}$ | | | | | | |

ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus, ChemSet™ Epcon™ G5 PRO

Performances

Diamond core drilling
Characteristic resistance for tension loads - rebar

Annex C 5

Table C7: Design method EN 1992-4
Characteristic values of resistance to shear load of threaded rod

| Steel failure without lever arm | | | | | | | | | |
|--|-------------------|-----------|------------|------------|------------|------------|------------|------------|------------|
| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Steel grade 4.6 | $V_{Rk,s}$ [kN] | 7 | 12 | 17 | 31 | 49 | 71 | 92 | 112 |
| Partial safety factor | γ_{Ms} [-] | 1,67 | | | | | | | |
| Steel grade 5.8 | $V_{Rk,s}$ [kN] | 9 | 15 | 21 | 39 | 61 | 88 | 115 | 140 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Steel grade 8.8 | $V_{Rk,s}$ [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Steel grade 10.9 | $V_{Rk,s}$ [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 |
| Partial safety factor | γ_{Ms} [-] | 1,5 | | | | | | | |
| Stainless steel grade A2-70, A4-70 | $V_{Rk,s}$ [kN] | 13 | 20 | 30 | 55 | 86 | 124 | 161 | 196 |
| Partial safety factor | γ_{Ms} [-] | 1,56 | | | | | | | |
| Stainless steel grade A4-80 | $V_{Rk,s}$ [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} [-] | 1,33 | | | | | | | |
| Stainless steel grade 1.4529 | $V_{Rk,s}$ [kN] | 13 | 20 | 30 | 55 | 86 | 124 | 161 | 196 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Stainless steel grade 1.4565 | $V_{Rk,s}$ [kN] | 13 | 20 | 30 | 55 | 86 | 124 | 161 | 196 |
| Partial safety factor | γ_{Ms} [-] | 1,56 | | | | | | | |
| Characteristic resistance of group of fasteners | | | | | | | | | |
| Ductility factor $k_7 = 1,0$ for steel with rupture elongation $A_5 > 8\%$ | | | | | | | | | |

| Steel failure with lever arm | | | | | | | | | |
|---|--------------------|-----------|------------|------------|------------|------------|------------|------------|------------|
| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Steel grade 4.6 | $M^o_{Rk,s}$ [N.m] | 15 | 30 | 52 | 133 | 260 | 449 | 666 | 900 |
| Partial safety factor | γ_{Ms} [-] | 1,67 | | | | | | | |
| Steel grade 5.8 | $M^o_{Rk,s}$ [N.m] | 19 | 37 | 66 | 166 | 325 | 561 | 832 | 1125 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Steel grade 8.8 | $M^o_{Rk,s}$ [N.m] | 30 | 60 | 105 | 266 | 519 | 898 | 1332 | 1799 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Steel grade 10.9 | $M^o_{Rk,s}$ [N.m] | 37 | 75 | 131 | 333 | 649 | 1123 | 1664 | 2249 |
| Partial safety factor | γ_{Ms} [-] | 1,50 | | | | | | | |
| Stainless steel grade A2-70, A4-70 | $M^o_{Rk,s}$ [N.m] | 26 | 52 | 92 | 233 | 454 | 786 | 1165 | 1574 |
| Partial safety factor | γ_{Ms} [-] | 1,56 | | | | | | | |
| Stainless steel grade A4-80 | $M^o_{Rk,s}$ [N.m] | 30 | 60 | 105 | 266 | 519 | 898 | 1332 | 1799 |
| Partial safety factor | γ_{Ms} [-] | 1,33 | | | | | | | |
| Stainless steel grade 1.4529 | $M^o_{Rk,s}$ [N.m] | 26 | 52 | 92 | 233 | 454 | 786 | 1165 | 1574 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Stainless steel grade 1.4565 | $M^o_{Rk,s}$ [N.m] | 26 | 52 | 92 | 233 | 454 | 786 | 1165 | 1574 |
| Partial safety factor | γ_{Ms} [-] | 1,56 | | | | | | | |
| Concrete pryout failure | | | | | | | | | |
| Factor for resistance to pry-out failure | k_8 [-] | 2 | | | | | | | |

| Concrete edge failure | | | | | | | | | |
|------------------------------|----------------|--------------------------------|------------|------------|------------|------------|------------|------------|------------|
| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Outside diameter of fastener | d_{nom} [mm] | 8 | 10 | 12 | 16 | 20 | 24 | 27 | 30 |
| Effective length of fastener | l_f [mm] | min (h_{ef} , 8 d_{nom}) | | | | | | | |

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

Performances

Design according to EN 1992-4
Characteristic resistance for shear loads - threaded rod

Annex C 6

Table C8: Design method EN 1992-4
Characteristic values of resistance to shear load of rebar

| Steel failure without lever arm | | | | | | | | |
|--|-------------------|-----------|------------|------------|------------|------------|------------|------------|
| Size | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Rebar BSt 500 S | $V_{Rk,s}$ [kN] | 14 | 22 | 31 | 55 | 86 | 135 | 221 |
| Partial safety factor | γ_{Ms} [-] | 1,5 | | | | | | |
| Characteristic resistance of group of fasteners | | | | | | | | |
| Ductility factor $k_7 = 1,0$ for steel with rupture elongation $A_5 > 8\%$ | | | | | | | | |

| Steel failure with lever arm | | | | | | | | |
|--|--------------------|-----------|------------|------------|------------|------------|------------|------------|
| Size | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Rebar BSt 500 S | $M^o_{Rk,s}$ [N.m] | 33 | 65 | 112 | 265 | 518 | 1013 | 2122 |
| Partial safety factor | γ_{Ms} [-] | 1,5 | | | | | | |
| Concrete pryout failure | | | | | | | | |
| Factor for resistance to pry-out failure | k_8 [-] | 2 | | | | | | |

| Concrete edge failure | | | | | | | | |
|------------------------------|----------------|-----------------------------|------------|------------|------------|------------|------------|------------|
| Size | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Outside diameter of fastener | d_{nom} [mm] | 8 | 10 | 12 | 16 | 20 | 25 | 32 |
| Effective length of fastener | l_f [mm] | min ($h_{ef}, 8 d_{nom}$) | | | | | | |

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

Performances
Design according to EN 1992-4
Characteristic resistance for shear loads - rebar

Annex C 7

Table C9: Displacement of threaded rod under tension and shear load
Hammer drilling, dustless drilling

| Size | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|----------------------------|------|------|------|------|------|------|------|------|
| Tension load | | | | | | | | |
| Uncracked concrete | | | | | | | | |
| δ_{N0} [mm/kN] | 0,03 | 0,02 | 0,02 | 0,02 | 0,01 | 0,01 | 0,01 | 0,01 |
| $\delta_{N\infty}$ [mm/kN] | 0,05 | 0,04 | 0,03 | 0,03 | 0,02 | 0,02 | 0,01 | 0,01 |
| Cracked concrete | | | | | | | | |
| δ_{N0} [mm/kN] | 0,05 | 0,04 | 0,03 | 0,03 | 0,02 | 0,02 | 0,02 | 0,02 |
| $\delta_{N\infty}$ [mm/kN] | 0,35 | 0,21 | 0,14 | 0,12 | 0,08 | 0,07 | 0,07 | 0,07 |
| Shear load | | | | | | | | |
| δ_{V0} [mm/kN] | 0,71 | 0,45 | 0,31 | 0,17 | 0,11 | 0,07 | 0,06 | 0,05 |
| $\delta_{V\infty}$ [mm/kN] | 1,06 | 0,67 | 0,46 | 0,25 | 0,16 | 0,11 | 0,08 | 0,07 |

Table C10: Displacement of threaded rod under tension and shear load
Diamond core drilling

| Size | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|----------------------------|------|------|------|------|------|------|------|------|
| Tension load | | | | | | | | |
| Uncracked concrete | | | | | | | | |
| δ_{N0} [mm/kN] | 0,01 | 0,01 | 0,02 | 0,02 | 0,02 | 0,02 | 0,01 | 0,02 |
| $\delta_{N\infty}$ [mm/kN] | 0,09 | 0,07 | 0,05 | 0,04 | 0,03 | 0,02 | 0,02 | 0,02 |
| Cracked concrete | | | | | | | | |
| δ_{N0} [mm/kN] | 0,03 | 0,04 | 0,04 | 0,04 | 0,03 | 0,03 | 0,04 | 0,04 |
| $\delta_{N\infty}$ [mm/kN] | 0,33 | 0,28 | 0,20 | 0,14 | 0,12 | 0,09 | 0,09 | 0,08 |
| Shear load | | | | | | | | |
| δ_{V0} [mm/kN] | 0,71 | 0,45 | 0,31 | 0,17 | 0,11 | 0,07 | 0,06 | 0,05 |
| $\delta_{V\infty}$ [mm/kN] | 1,06 | 0,67 | 0,46 | 0,25 | 0,16 | 0,11 | 0,08 | 0,07 |

Table C11: Displacement of rebar under tension and shear load
Hammer drilling, dustless drilling

| Size | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
|----------------------------|------|------|------|------|------|------|------|
| Tension load | | | | | | | |
| Uncracked concrete | | | | | | | |
| δ_{N0} [mm/kN] | 0,04 | 0,03 | 0,02 | 0,01 | 0,01 | 0,01 | 0,01 |
| $\delta_{N\infty}$ [mm/kN] | 0,08 | 0,05 | 0,04 | 0,02 | 0,02 | 0,01 | 0,01 |
| Cracked concrete | | | | | | | |
| δ_{N0} [mm/kN] | 0,05 | 0,04 | 0,03 | 0,03 | 0,02 | 0,02 | 0,02 |
| $\delta_{N\infty}$ [mm/kN] | 0,35 | 0,21 | 0,17 | 0,11 | 0,08 | 0,07 | 0,06 |
| Shear load | | | | | | | |
| δ_{V0} [mm/kN] | 0,38 | 0,24 | 0,17 | 0,10 | 0,06 | 0,04 | 0,02 |
| $\delta_{V\infty}$ [mm/kN] | 0,56 | 0,36 | 0,25 | 0,14 | 0,09 | 0,06 | 0,04 |

Table C12: Displacement of rebar under tension and shear load
Diamond drilling

| Size | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
|----------------------------|------|------|------|------|------|------|------|
| Tension load | | | | | | | |
| Uncracked concrete | | | | | | | |
| δ_{N0} [mm/kN] | 0,02 | 0,02 | 0,02 | 0,01 | 0,01 | 0,01 | 0,01 |
| $\delta_{N\infty}$ [mm/kN] | 0,09 | 0,06 | 0,04 | 0,03 | 0,02 | 0,01 | 0,01 |
| Cracked concrete | | | | | | | |
| δ_{N0} [mm/kN] | 0,04 | 0,03 | 0,03 | 0,02 | 0,02 | 0,01 | 0,01 |
| $\delta_{N\infty}$ [mm/kN] | 0,39 | 0,26 | 0,18 | 0,10 | 0,07 | 0,04 | 0,03 |
| Shear load | | | | | | | |
| δ_{V0} [mm/kN] | 0,38 | 0,24 | 0,17 | 0,10 | 0,06 | 0,04 | 0,02 |
| $\delta_{V\infty}$ [mm/kN] | 0,56 | 0,36 | 0,25 | 0,14 | 0,09 | 0,06 | 0,04 |

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

**Performances
Displacements**

Annex C 8

Table C13: Seismic performance category C1 of threaded rod - Hammer drilling, Dustless drilling

| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|---|----------------------|----------------------|------|------|------|------|------|------|------|------|
| Tension load | | | | | | | | | | |
| Steel failure | | | | | | | | | | |
| Characteristic resistance grade 4.6 | $N_{Rk,s,eq,C1}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} | [-] | 2,00 | | | | | | | |
| Characteristic resistance grade 5.8 | $N_{Rk,s,eq,C1}$ | [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Characteristic resistance grade 8.8 | $N_{Rk,s,eq,C1}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Characteristic resistance grade 10.9 | $N_{Rk,s,eq,C1}$ | [kN] | 37 | 58 | 84 | 157 | 245 | 353 | 459 | 561 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | | | |
| Characteristic resistance A2-70, A4-70 | $N_{Rk,s,eq,C1}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | |
| Characteristic resistance A4-80 | $N_{Rk,s,eq,C1}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 |
| Partial safety factor | γ_{Ms} | [-] | 1,60 | | | | | | | |
| Characteristic resistance 1.4529 | $N_{Rk,s,eq,C1}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Characteristic resistance 1.4565 | $N_{Rk,s,eq,C1}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | |
| Combined pullout and concrete cone failure in concrete C20/25 for a working life of 50 years and 100 years | | | | | | | | | | |
| Characteristic bond resistance | | | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,p,eq,C1}$ | [N/mm ²] | 9,4 | 8,5 | 10,0 | 8,7 | 7,4 | 7,7 | 5,7 | 4,9 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | | | |
| Dry, wet concrete | γ_{inst} | [-] | 1,0 | | | | | | | |
| Hammer drilling – Flooded hole | γ_{inst} | [-] | 1,0 | | | | | | | |
| Dustless drilling – Flooded hole | γ_{inst} | [-] | 1,2 | | | | | | | |
| Shear load | | | | | | | | | | |
| Steel failure without lever arm | | | | | | | | | | |
| Characteristic resistance grade 4.6 | $V_{Rk,s,eq,C1}$ | [kN] | 5 | 9 | 13 | 20 | 32 | 28 | 37 | 45 |
| Partial safety factor | γ_{Ms} | [-] | 1,67 | | | | | | | |
| Characteristic resistance grade 5.8 | $V_{Rk,s,eq,C1}$ | [kN] | 7 | 11 | 16 | 26 | 40 | 35 | 46 | 56 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Characteristic resistance grade 8.8 | $V_{Rk,s,eq,C1}$ | [kN] | 11 | 17 | 25 | 41 | 64 | 56 | 73 | 90 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Characteristic resistance grade 10.9 | $V_{Rk,s,eq,C1}$ | [kN] | 14 | 22 | 32 | 51 | 80 | 71 | 92 | 112 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Characteristic resistance A2-70, A4-70 | $V_{Rk,s,eq,C1}$ | [kN] | 10 | 15 | 22 | 36 | 56 | 49 | 64 | 79 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | | | |
| Characteristic resistance A4-80 | $V_{Rk,s,eq,C1}$ | [kN] | 11 | 17 | 25 | 41 | 64 | 56 | 73 | 90 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | | | |
| Characteristic resistance 1.4529 | $V_{Rk,s,eq,C1}$ | [kN] | 10 | 15 | 22 | 36 | 56 | 49 | 64 | 79 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Characteristic resistance 1.4565 | $V_{Rk,s,eq,C1}$ | [kN] | 10 | 15 | 22 | 36 | 56 | 49 | 64 | 79 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | | | |
| Characteristic shear load resistance $V_{Rk,s,eq}$ in the Table C7 shall be multiplied by following reduction factor for hot-dip galvanized commercial standard rods | | | | | | | | | | |
| Reduction factor for hot-dip galvanized rods | $\alpha_{v,h-dg,c1}$ | [-] | 0,47 | 0,47 | 0,47 | 0,54 | 0,54 | 0,88 | 0,88 | 0,88 |
| Factor for annular gap | α_{gap} | [-] | 0,5 | | | | | | | |

The anchor shall be used with minimum rupture elongation after fracture $A_5 \geq 9\%$.

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

Performances
Hammer drilling, Dustless drilling
Seismic performance category C1 of threaded rod

Annex C 9

Table C14: Seismic performance category C1 of rebar - Hammer drilling, Dustless drilling

| Size | | | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
|---|---------------------|----------------------|-----|-----|-----|-----|-----|-----|
| Tension load | | | | | | | | |
| Steel failure | | | | | | | | |
| Rebar BSt 500 S | $N_{Rk,s,eq,C1}$ | [kN] | 43 | 62 | 111 | 173 | 270 | 442 |
| Partial safety factor | γ_{Ms} | [-] | 1,4 | | | | | |
| Combined pullout and concrete cone failure in concrete C20/25 for a working life of 50 years and 100 years | | | | | | | | |
| Characteristic bond resistance | | | | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,p,eq,C1}$ | [N/mm ²] | 9,4 | 9,8 | 9,5 | 8,8 | 8,0 | 5,3 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | | | | |
| Hammer drilling - Dry, wet concrete | γ_{inst} | [-] | 1,0 | | | | | |
| Dustless drilling - Dry, wet concrete | γ_{inst} | [-] | 1,2 | | | | | |
| Flooded hole | γ_{inst} | [-] | 1,2 | | | | | |
| Shear load | | | | | | | | |
| Steel failure without lever arm | | | | | | | | |
| Rebar BSt 500 S | $V_{Rk,s,eq,C1}$ | [kN] | 16 | 23 | 41 | 69 | 67 | 111 |
| Partial safety factor | γ_{Ms} | [-] | 1,5 | | | | | |
| Factor for annular gap | α_{gap} | [-] | 0,5 | | | | | |

**ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus,
ChemSet™ Epcon™ G5 PRO**

Performances
Hammer drilling, Dustless drilling
Seismic performance category C1 of rebar

Annex C 10

Table C15: Seismic performance category C2 of threaded rod - Hammer drilling, Dustless drilling

| Size | | | M12 | M16 | M20 |
|---|----------------------|----------------------|------|------|------|
| Tension load | | | | | |
| Steel failure | | | | | |
| Characteristic resistance grade 4.6 | $N_{Rk,s,eq,C2}$ | [kN] | 34 | 63 | 98 |
| Partial safety factor | γ_{Ms} | [-] | 2,00 | | |
| Characteristic resistance grade 5.8 | $N_{Rk,s,eq,C2}$ | [kN] | 42 | 79 | 123 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | |
| Characteristic resistance grade 8.8 | $N_{Rk,s,eq,C2}$ | [kN] | 67 | 126 | 196 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | |
| Characteristic resistance grade 10.9 | $N_{Rk,s,eq,C2}$ | [kN] | 84 | 157 | 245 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | |
| Characteristic resistance A2-70, A4-70 | $N_{Rk,s,eq,C2}$ | [kN] | 59 | 110 | 172 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | |
| Characteristic resistance A4-80 | $N_{Rk,s,eq,C2}$ | [kN] | 67 | 126 | 196 |
| Partial safety factor | γ_{Ms} | [-] | 1,60 | | |
| Characteristic resistance 1.4529 | $N_{Rk,s,eq,C2}$ | [kN] | 59 | 110 | 172 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | |
| Characteristic resistance 1.4565 | $N_{Rk,s,eq,C2}$ | [kN] | 59 | 110 | 172 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | |
| Combined pullout and concrete cone failure in concrete C20/25 for a working life of 50 years and 100 years | | | | | |
| Characteristic bond resistance | | | | | |
| Dry and wet concrete, Flooded hole | $\tau_{Rk,p,eq,C2}$ | [N/mm ²] | 3,5 | 4,0 | 4,5 |
| Installation safety factor for Dry and Wet concrete, Flooded hole | | | | | |
| Dry and wet concrete, Flooded hole | γ_{inst} | [-] | 1,0 | | |
| Dustless drilling – Flooded hole | γ_{inst} | [-] | 1,2 | | |
| Shear load | | | | | |
| Steel failure without lever arm | | | | | |
| Characteristic resistance grade 4.6 | $V_{Rk,s,eq,C2}$ | [kN] | 13 | 18 | 28 |
| Partial safety factor | γ_{Ms} | [-] | 1,67 | | |
| Characteristic resistance grade 5.8 | $V_{Rk,s,eq,C2}$ | [kN] | 16 | 22 | 35 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | |
| Characteristic resistance grade 8.8 | $V_{Rk,s,eq,C2}$ | [kN] | 25 | 36 | 56 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | |
| Characteristic resistance grade 10.9 | $V_{Rk,s,eq,C2}$ | [kN] | 32 | 45 | 70 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | |
| Characteristic resistance A2-70, A4-70 | $V_{Rk,s,eq,C2}$ | [kN] | 22 | 31 | 49 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | |
| Characteristic resistance A4-80 | $V_{Rk,s,eq,C2}$ | [kN] | 25 | 36 | 56 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | |
| Characteristic resistance 1.4529 | $V_{Rk,s,eq,C2}$ | [kN] | 22 | 31 | 49 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | |
| Characteristic resistance 1.4565 | $V_{Rk,s,eq,C2}$ | [kN] | 22 | 31 | 49 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | |
| Characteristic shear load resistance $V_{Rk,s,eq}$ in the Table C9 shall be multiplied by following reduction factor for hot-dip galvanized commercial standard rods | | | | | |
| Reduction factor for hot-dip galvanized rods | $\alpha_{v,h-dg,c2}$ | [-] | 0,46 | 0,61 | 0,61 |
| Factor for annular gap | α_{gap} | [-] | 0,5 | | |

Table C16: Displacement under tensile and shear load - seismic category C2 of threaded rod

| Size | | M12 | M16 | M20 |
|----------------------|------|-------|------|-------|
| $\delta_{N,eq}(DLS)$ | [mm] | 0,20 | 0,40 | 0,77 |
| $\delta_{N,eq}(ULS)$ | [mm] | 0,76 | 0,74 | 1,68 |
| $\delta_{V,eq}(DLS)$ | [mm] | 5,29 | 4,12 | 4,94 |
| $\delta_{V,eq}(ULS)$ | [mm] | 10,20 | 9,05 | 10,99 |

The anchor shall be used with minimum rupture elongation after fracture $A_5 \geq 9\%$.

ChemSet™ Reo502™ Plus, ChemSet™ Epcon™ C6 Plus, ChemSet™ Epcon™ G5 PRO

Performances

Hammer drilling, Dustless drilling
Seismic performance category C2 of threaded rod

Annex C 11